









Better Boilers

P-267C

SL 10-85/14-115/20-160/30-199 G3
& HC/DC Boilers

Vertical Floor Stand

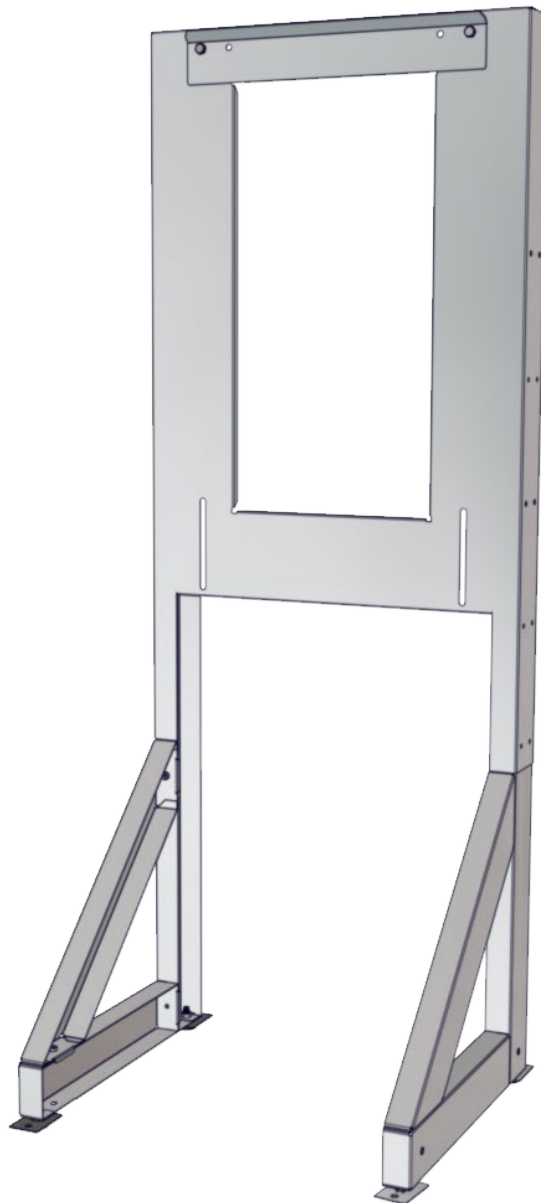

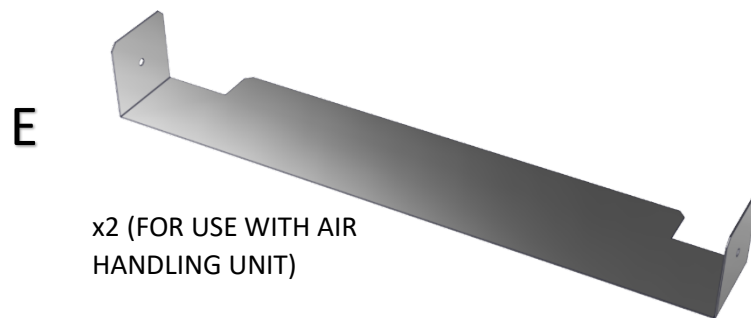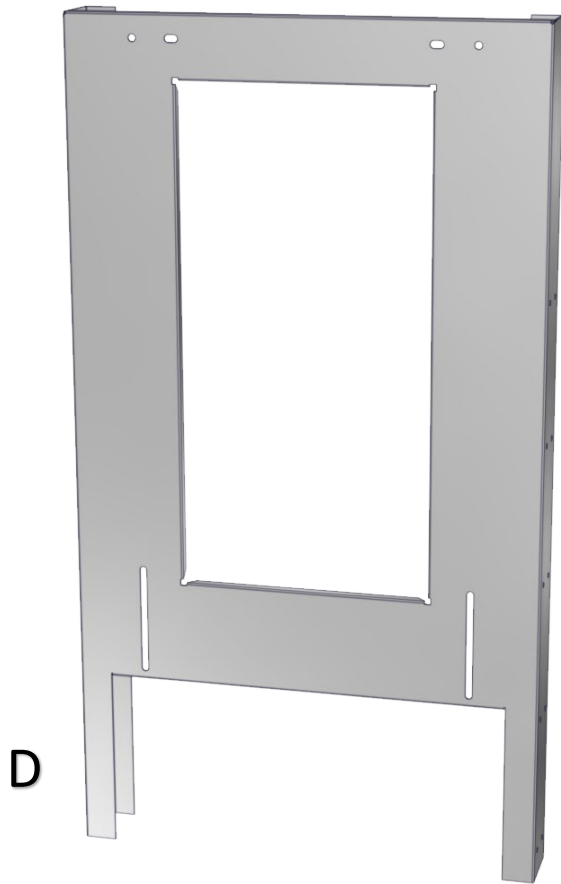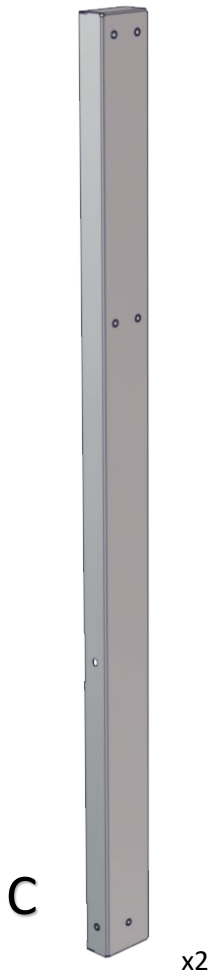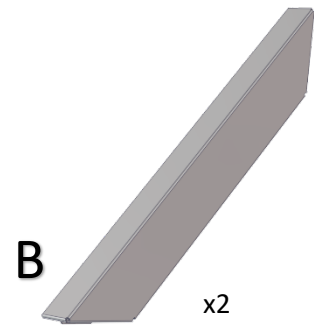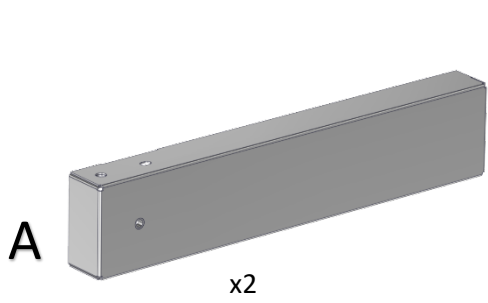



18x 150-025





18x 150-026




18x 150-029


8x 150-281



I




4x 5/16" x 1-1/4"
ELEVATOR BOLT

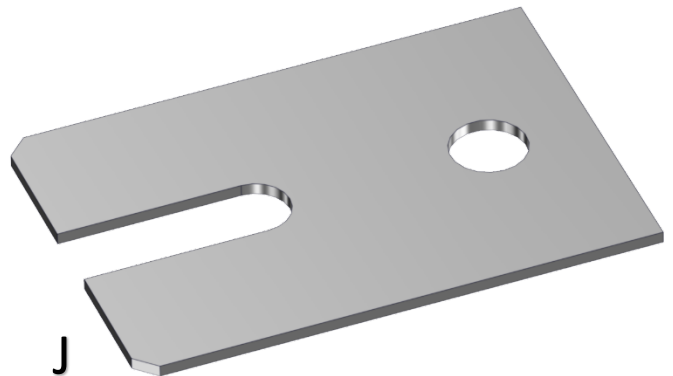

4x 250-895

K



4x 150-284

L





4x 150-283

Assembling the floor stand


Step 1

PROCEED TO STEP 2 IF AN AHU IS TO BE INSTALLED. DO NOT INSTALL ELEVATOR BOLTS.

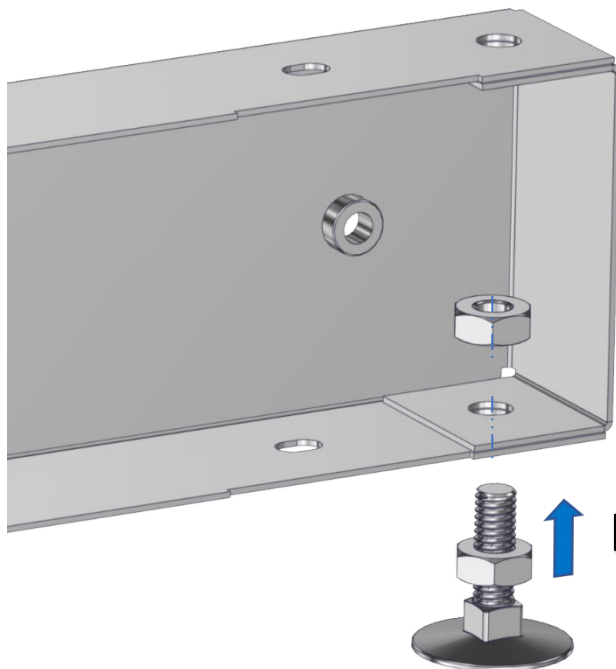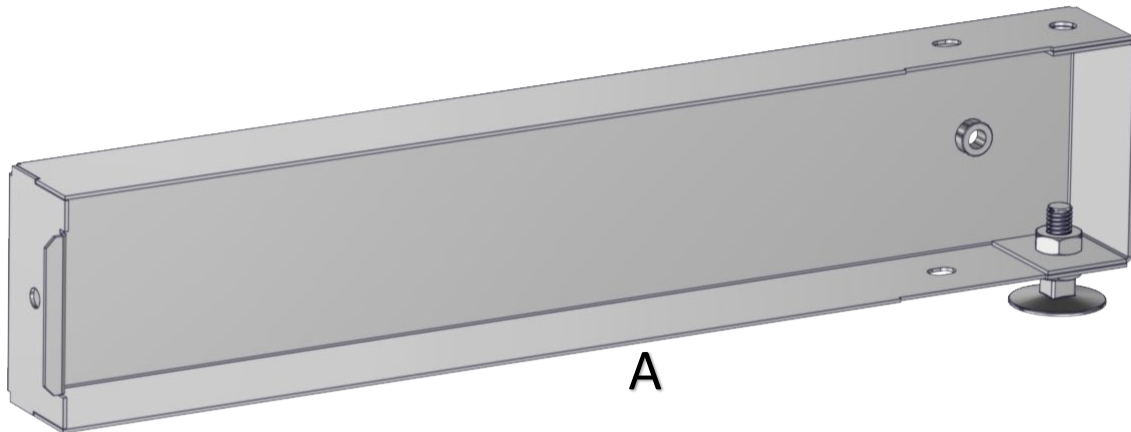



Step 2

LEFT AND RIGHT LEGS

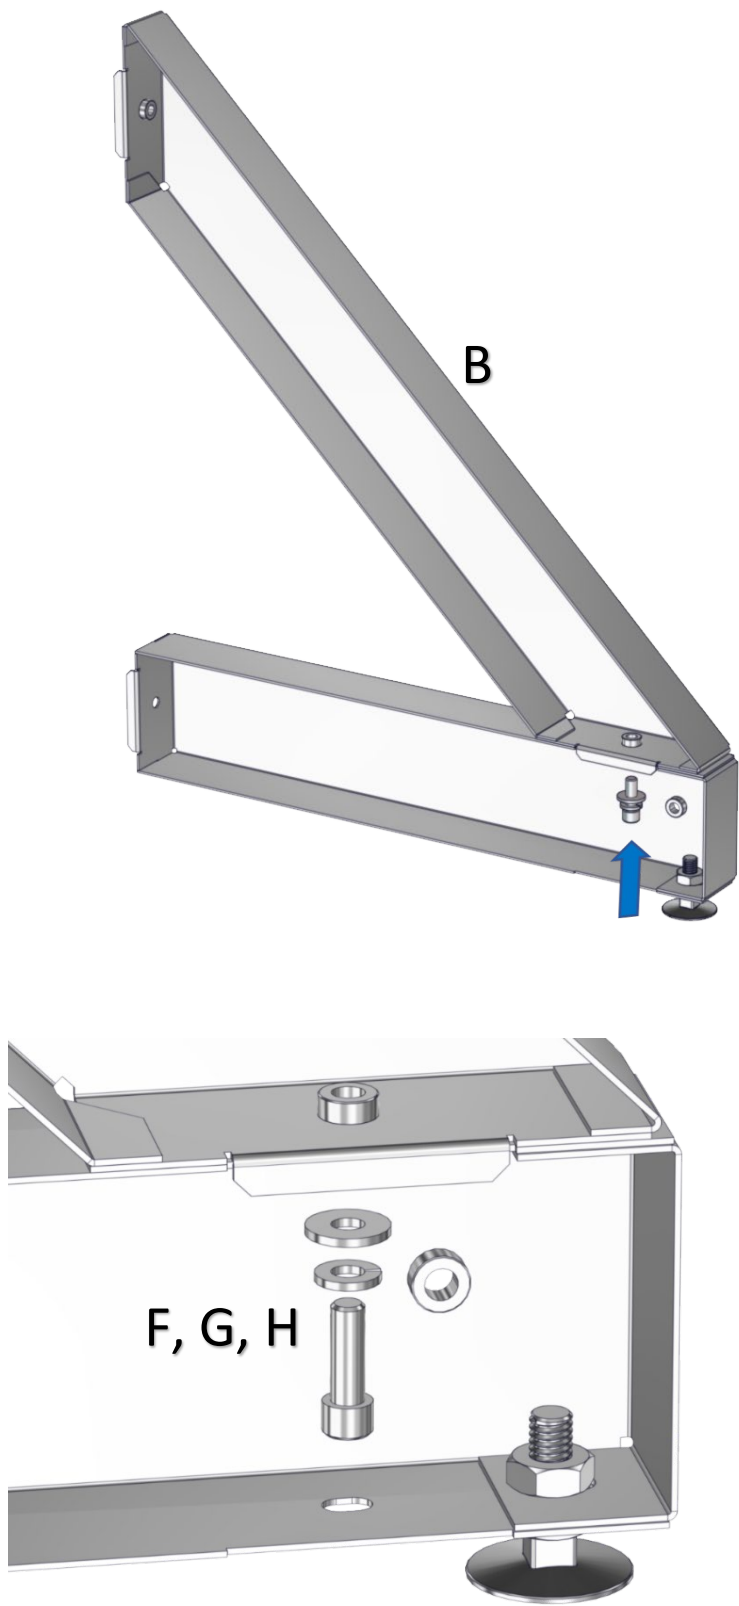


Step 3

LEFT AND RIGHT LEGS

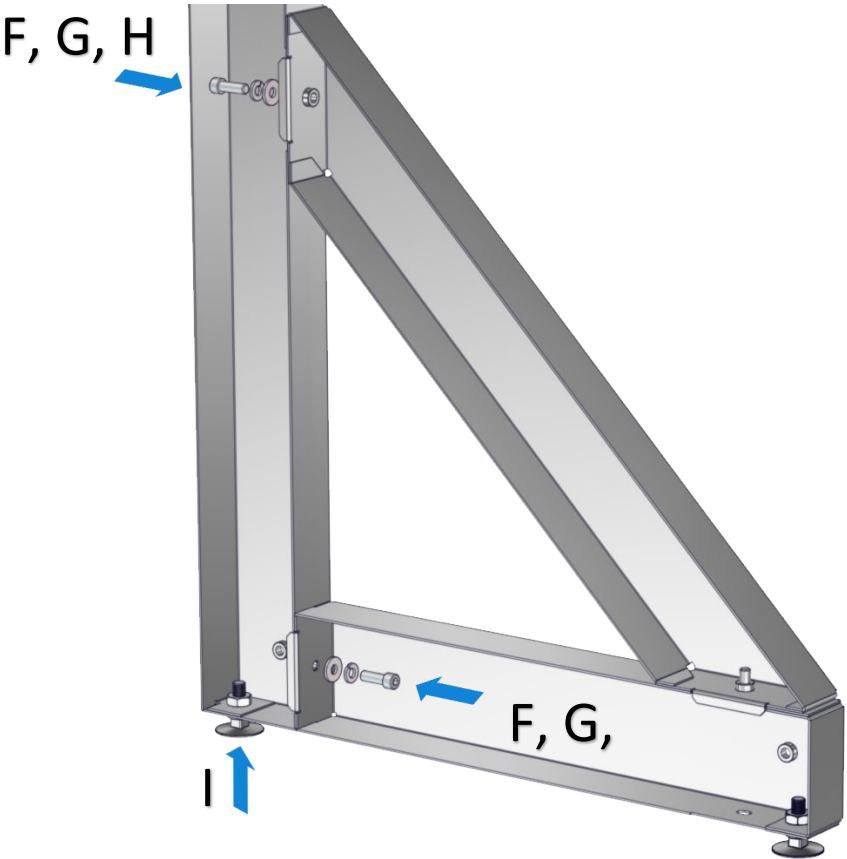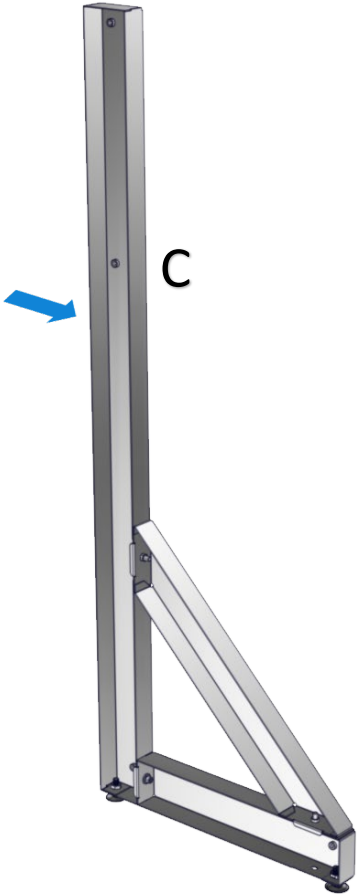


Step 4

ADJUST HEIGHT AS NEEDED


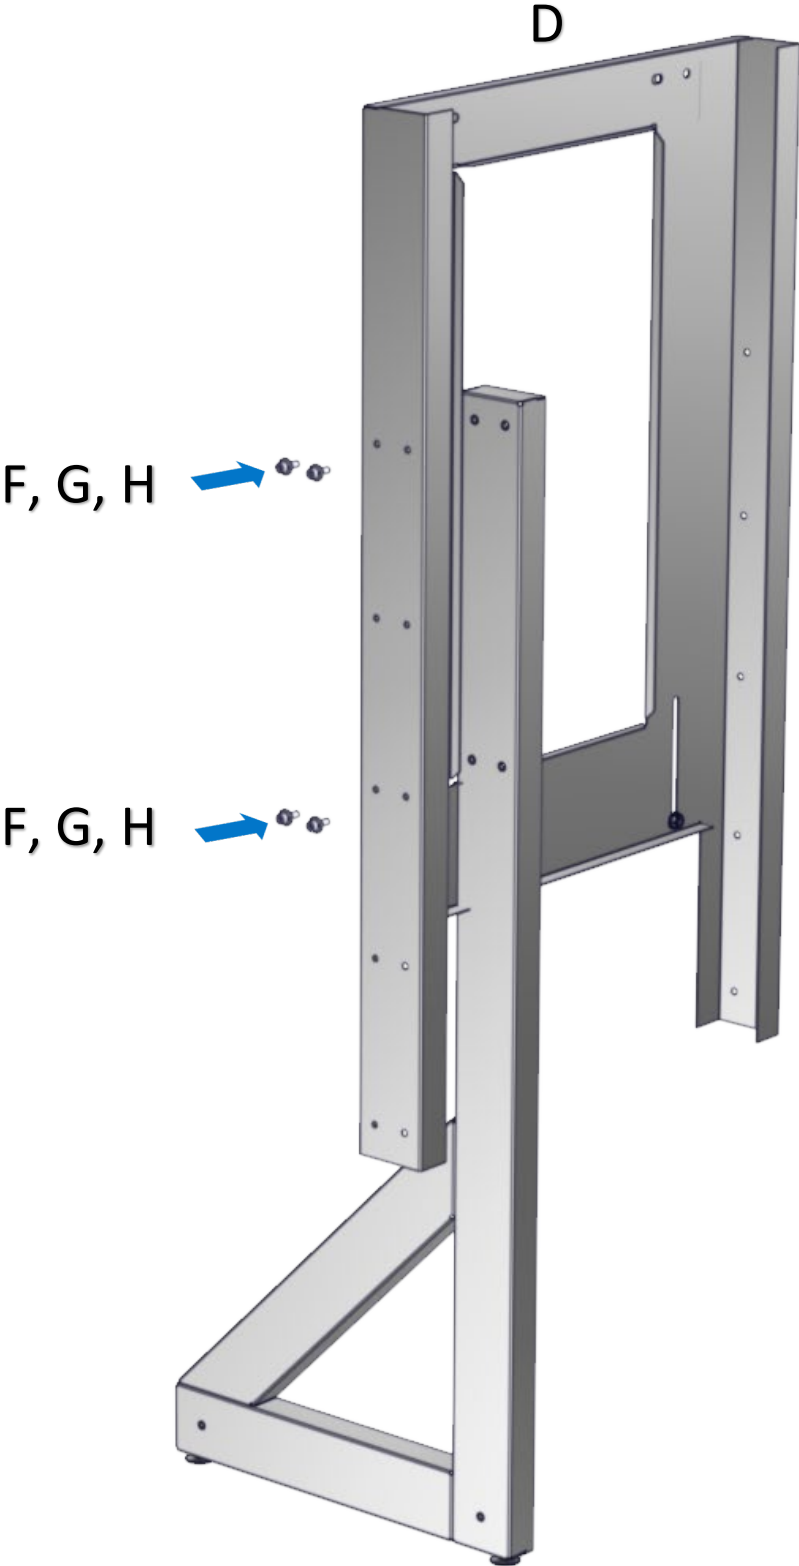


Step 5

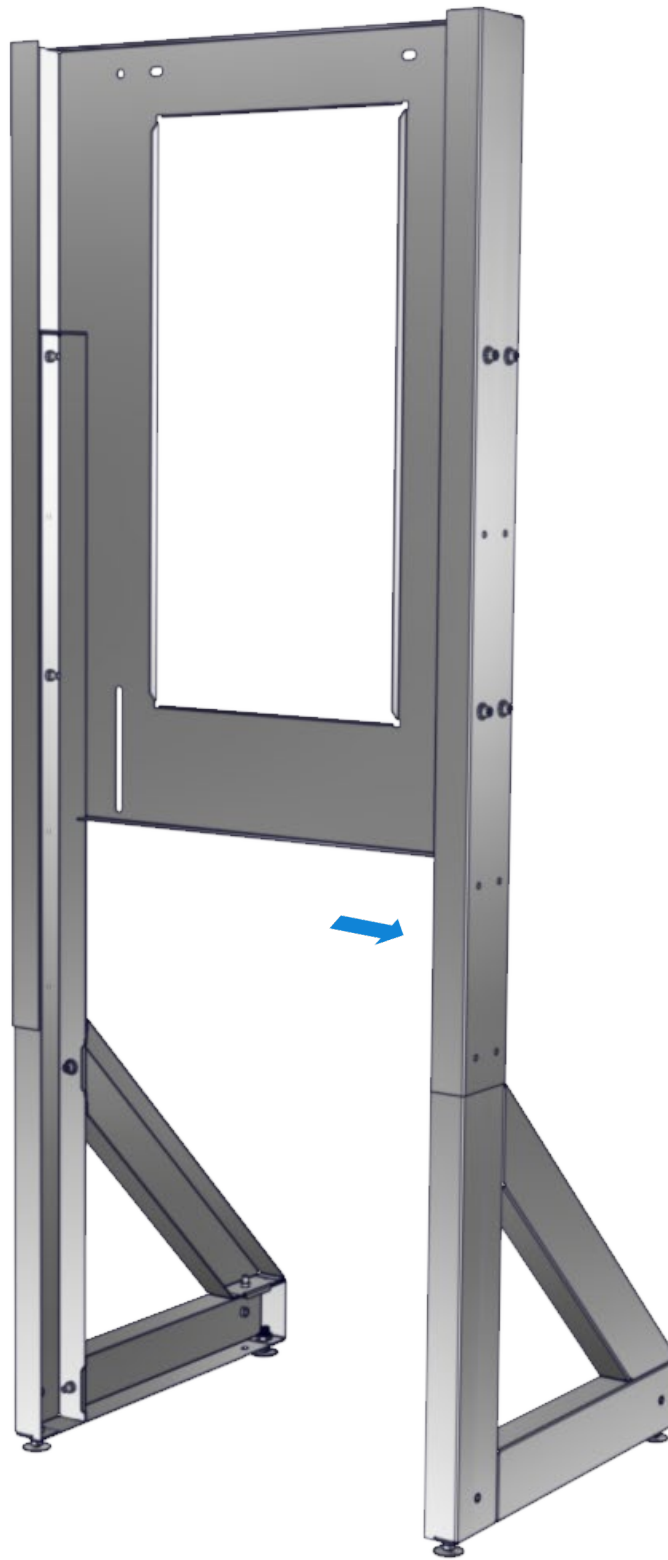


Step 6

INSTALL FRAME ANCHOR BRACKETS (PART E) ONLY IF AHU IS INSTALLED

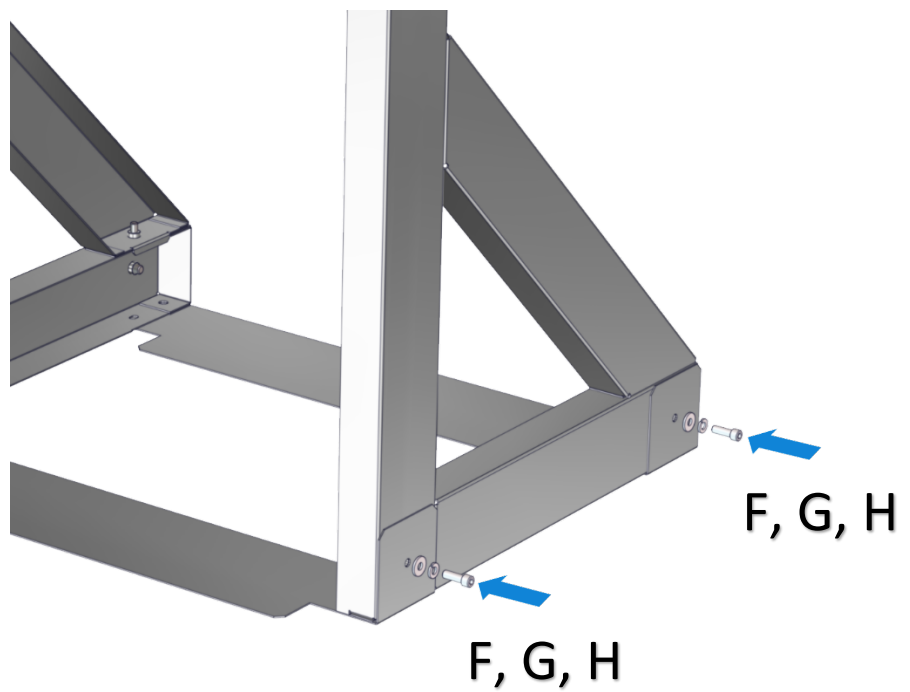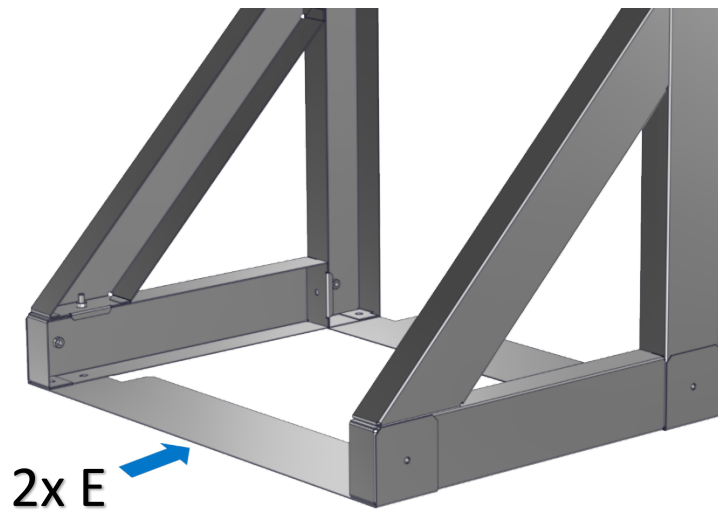

Mounting the boiler


Step 1

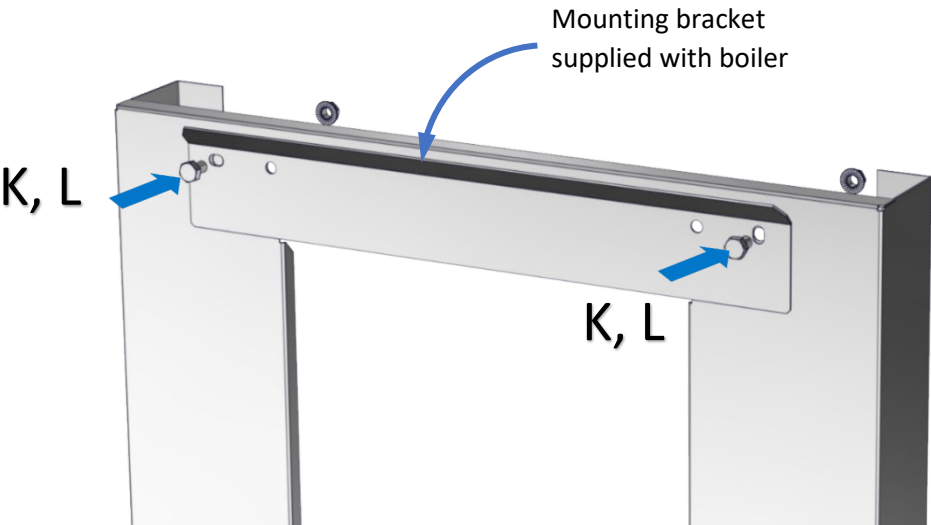

Step 2



Step 3

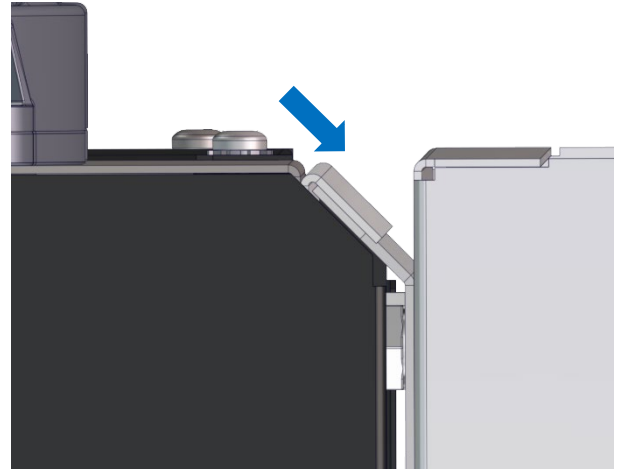

Step 4

